

# A Solution to Global Warming, Air Pollution, and Energy Insecurity for Austria

By Mark Z. Jacobson, Stanford University, January 13, 2024

This infographic summarizes results from simulations that demonstrate the ability of Austria to match all-purpose energy demand with wind-water-solar (WWS) electricity and heat supply, storage, and demand response continuously every 30 seconds for three years (2050-2052). All-purpose energy is for electricity, transportation, buildings, industry, agriculture/forestry/fishing, and the military. The ideal transition timeline is 100% WWS by 2035; however, results are shown for 2050-2052, after additional population growth has occurred. Results are given for Austria interconnected within the Europe (Albania, Austria, Belarus, Belgium, Bosnia-Herzegovina, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Gibraltar, Greece, Hungary, Ireland, Italy, Kosovo, Latvia, Lithuania, Luxembourg, Macedonia, Malta, Moldova Republic, Montenegro, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Ukraine, United Kingdom) and for the Austria region itself.

WWS electricity-generating technologies include onshore and offshore wind turbines, rooftop and utility solar photovoltaics (PV), concentrated solar power (CSP) plants, geothermal plants, hydro plants, tidal turbines, and wave devices. WWS heat-generating technologies include geothermal and solar thermal technologies. WWS storage includes electricity, heat, cold, and hydrogen storage. Electricity storage options include hydropower, pumped hydropower, batteries, CSP with storage, and hydrogen fuel cells. WWS equipment includes electric and hydrogen fuel cell vehicles, heat pumps, induction cooktops, arc furnaces, induction furnaces, resistance furnaces, lawnmowers, etc. Green hydrogen is used for ammonia and steel manufacturing, long-distance transport, and grid storage. No fossil fuels, nuclear, bioenergy, carbon capture, direct air capture, or blue hydrogen is included.

The results are derived from the LOADMATCH model using 2020 business-as-usual (BAU) country demand data by energy sector and fuel type (IEA, 2023), projected to 2050 then converted to demand powered by wind-water-solar (WWS) electricity and heat. LOADMATCH uses 30-s resolution 2050 WWS supply and building heating/cooling demand data calculated from the GATOR-GCMOM weather-prediction model. Citation:

Jacobson, M.Z., D. Fu, D.J. Sambor, and A. Mühlbauer, On the energy, health, and climate costs of “all-of-the-above” versus 100% Wind-Water-Solar (WWS) climate policies: Analysis across 149 countries, 2024. <https://web.stanford.edu/group/efmh/jacobson/Articles/I/WWS-149-Countries.html>

## Main results. Transitioning Austria to 100% WWS for all energy purposes...

**Keeps the grid stable 100% of the time;**

**Saves 1,700 lives per year from air pollution in 2050 in Austria;**

**Eliminates 87 million tonnes-CO<sub>2</sub>e per year in 2050 in Austria;**

**Reduces 2050 all-purpose, end-use energy requirements by 55.8%;**

**Reduces Austria's 2050 annual energy costs by 62.7% (from \$38.8 to \$14.5 bil/y);**

**Reduces annual energy, health, plus climate costs by 86.5% (from \$108 to \$14.5 bil/y);**

**Costs ~\$92 billion upfront for WWS electricity, heat, and H<sub>2</sub> generation; electricity, heat, cold, and H<sub>2</sub> storage; heat pumps for district heating; all-distance transmission; and distribution. The payback time due to WWS annual energy cost savings vs. BAU is 3.8 years; that due to annual energy+health+climate cost savings is 1.0 years;**

**~31.7% of the WWS generator nameplate capacity needed has been installed;**

**New WWS requires 0.45% of Austria's land for footprint, 0.63% for spacing;**

**Creates 62,400 more long-term, full-time jobs than lost (not including increases in jobs in producing electric appliances, vehicles, machines) in Austria.**

# Table of Contents

<b>Table 1. Reduced End-Use Demand Upon a Transition From BAU to WWS</b>
<b>Table 2. 2050 WWS End-Use Demand by Sector</b>
<b>Table 3. WWS End-Use Demand by Demand Type</b>
<b>Table 4. Mass of Hydrogen Needed for Steel, Ammonia, and Long-Distance Transport</b>
<b>Table 5. Nameplate Capacities Needed by 2050 and Installed as of 2022</b>
<b>Table 6. Capacity Factors of WWS Generators</b>
<b>Table 7. Percent of Demand Met by Different WWS Generators</b>
<b>Table 8. Characteristics of Storage Resulting in Matching Demand With 100% WWS Supply</b>
<b>Figure 1. Keeping the Electric Grid Stable With 100% WWS + Storage + Demand Response</b>
<b>Table 9. Summary of Energy Budget Resulting in Grid Stability</b>
<b>Table 10. Details of Energy Budget Resulting in Grid Stability</b>
<b>Table 11. Breakdown of Energy Costs Required to Keep Grid Stable</b>
<b>Table 12. Energy, Health, and Climate Costs of WWS Versus BAU</b>
<b>Table 13. Air Pollution Mortalities, Carbon Dioxide Emissions, and Associated Costs</b>
<b>Table 14. Land Areas Needed</b>
<b>Table 15. Changes in Employment</b>
<b>References</b>
<b>Additional Background Material on 100% WWS</b>

**Table 1. Reduced End-Use Demand Upon a Transition From BAU to WWS**

1<sup>st</sup> row: 2020 annually-averaged end-use demand (GW) and percentage of the demand by sector. 2<sup>nd</sup> row: projected 2050 annually-averaged end-use BAU demand (GW) and percentage of the total demand by sector. 3<sup>rd</sup> row: estimated 2050 total end-use demand (GW) and percentage of total demand by sector if 100% of end-use delivered BAU demand in 2050 is instead provided by WWS. Column (k) shows the percentage reductions in total 2050 BAU demand due to switching from BAU to WWS, including the effects of (h) energy use reduction due to the higher work to energy ratio of electricity over combustion, (i) eliminating energy use for the upstream mining, transporting, and/or refining of coal, oil, gas, biofuels, bioenergy, and uranium, and (j) policy-driven increases in end-use efficiency beyond those in the BAU case. Column (l) is the ratio of electricity demand (=all energy demand) in the 2050 WWS case to the electricity demand in the 2050 BAU case. Whereas Column (l) shows that electricity consumption increases in the WWS versus BAU cases, Column (k) shows that all energy decreases.

Scenario	(a) Total annual- average end-use demand (GW)	(b) Resi- den- tial % of total	(c) Com- merci- al % of total	(d) Indus- try % of total	(e) Trans- port % of total	(f) Ag-for- fish % of total	(g) Mil- itary- other % of total	(h) % change end- use deman- d with WWS due to higher work: energy ratio	(i) % change end- use deman- d with WWS due to elim- inating up- stream	(j) % change end- use deman- d with WWS due to effic- iency beyon- d BAU	(k) Over- all % change in end- use deman- d with WWS	(l) WWS :BAU elec- tric- ity dem- and
<b>Austria</b>												
BAU 2020	35.5	24.4	8.8	34.4	30.4	1.92	0.00					
BAU 2050	44.0	23.8	9.1	31.8	33.7	1.60	0.00					
WWS 2050	19.5	19.6	11.5	45.7	22.1	1.17	0.00	-38.25	-10.75	-6.82	-55.82	1.69
<b>Europe</b>												
BAU 2020	1,676.7	24.9	11.6	30.3	30.2	2.74	0.28					
BAU 2050	2,053.7	25.4	12.8	29.3	29.9	2.38	0.24					
WWS 2050	876.4	22.2	17.0	39.9	19.1	1.69	0.14	-11.5	-2.8	-2.3	-57.3	5.20

The reductions in Column (h) are due primarily to the efficiency of electric and hydrogen fuel cell vehicles over internal combustion engine vehicles, the efficiency of heat pumps for air and water heating over combustion and electric resistance heaters, and the efficiency of electricity rather than combustion for high-temperatures.

**Table 2. 2050 WWS End-Use Demand by Sector**

2050 annual average end-use electric plus heat demand (GW) by sector after energy in all sectors has been converted to WWS. Instantaneous demands can be higher or lower than annual average demands. Values for a region equal the sum of values among all countries in the region.

Country or region	Total	Resi- dential	Com- merci- al	Trans- port	Industrial	Agricul- ture/fores- try/fishing	Military/ other
Europe	876.4	194.32	148.66	349.71	167.71	14.81	1.23

**Table 3. WWS End-Use Demand by Demand Type**

Annual-average WWS all-sector inflexible and flexible demands (GW) for 2050. “Total demand” is the sum of columns (b) and (c). “Flexible demand” is the sum of columns (d)-(g). DR is demand-response. “Demand for non-grid H<sub>2</sub>” accounts for the production, compression, storage, and leakage of hydrogen. Annual-average demands are distributed in time at 30-s resolution. Instantaneous demands, either flexible or inflexible, can be much higher or lower than annual-average demands. Column (h) shows the annual hydrogen mass production rate needed for steel and ammonia manufacturing and long-distance transport, estimated as the H<sub>2</sub> demand multiplied by 8,760 h/y and divided by 47.01 kWh/kg-H<sub>2</sub>.

Country or region	(a) Total end-use demand (GW) =b+c	(b) Inflexible demand (GW)	(c) Flexible demand (GW) =d+e+f+g	(d) Cold demand subject to storage (GW)	(e) Low-temperature heat demand subject to storage (GW)	(f) Demand subject to DR	(g) Demand for non-grid H <sub>2</sub> (GW)	(h) Non-grid H <sub>2</sub> needed (Tg-H <sub>2</sub> /y)
Europe	876.4	394.3	482.1	12.8	120.2	237.4	111.7	20.78

**Table 4. Mass of Hydrogen Needed for Steel, Ammonia, and Long-Distance Transport**

2050 mass of hydrogen needed per year for (a) steel manufacturing, (b) ammonia manufacturing, (c) long-distance hydrogen fuel cell-electric vehicles, (d) the sum of all of these by country and world region, (e) power needed to produce and compress hydrogen for steel plus ammonia manufacturing, (f) power needed to produce and compress hydrogen for transportation, and (g) power needed to produce and compress hydrogen for steel and ammonia manufacturing and transportation.

Region or country	(a) 2050 Tg-H <sub>2</sub> /y needed to purify iron by hydrogen direct reduction	(b) 2050 Tg-H <sub>2</sub> /y needed to make NH <sub>3</sub>	(c) 2050 Tg-H <sub>2</sub> /y needed for HFC vehicles	(d) 2050 Total Tg-H <sub>2</sub> /y produced for steel, ammonia, and vehicles = a+b+c	(e) 2050 Power needed to produce and compress H <sub>2</sub> for steel and ammonia (GW)	(f) 2050 power needed to produce and compress H <sub>2</sub> for transport (GW)	(g) 2050 power needed to produce and compress H <sub>2</sub> for steel, ammonia, and transport (GW) = e+f
Austria	0.330	0.091	0.219	0.640	2.264	1.180	3.443

**Table 5. Nameplate Capacities Needed by 2050 and Installed as of 2022**

Final (from LOADMATCH) 2050 total (existing plus new) nameplate capacity (GW) of WWS generators needed to match power demand with supply, storage, and demand response continuously during 2050-2052. Also given are nameplate capacities already installed as of 2022 end. Nameplate capacity equals the maximum possible instantaneous discharge rate.

Year	Onshore wind	Off-shore wind	Residential rooftop PV	Comm /govt rooftop PV	Utility PV	CSP with storage	Geothermal electricity	Hydro power	Wave	Tidal	Solar thermal	Geothermal heat	Total
2022 Austria	3.736	0	0.44	1.0467	2.0614	0	0.001	14.969	0	0	3.446	1.0958	<b>26.796</b>
2022 Europe	209.94	30.66	27.96	66.51	131.00	2.315	0.877	194.4	0.0001	0.2401	40.31	31.64	<b>735.9</b>
2050 Austria	14.08	0.00	7.75	10.83	32.26	0.03	0.00	14.969	0.000	0.000	3.446	1.0958	<b>84.5</b>
2050 Europe	891	350.3	341.4	498.8	1,469	3.81	3.192	194.39	2.652	1.543	40.31	31.64	<b>3,828</b>

**Table 6. Capacity Factors of WWS Generators**

Simulation-averaged 2050-2052 capacity factors (percentage of nameplate capacity produced as electricity before transmission, distribution, maintenance, storage, or curtailment losses). The mean capacity factors in this table equal the simulation-averaged power output supplied by each generator in each region from Table 7 divided by the final nameplate capacity of each generator in each region from Table 5.

Country or region	On-shore wind	Off-shore wind	Rooftop PV	Utility PV	CSP with storage	Geo-thermal elec-tricity	Hydr opower	Wave	Tidal	Solar therm al	Geo-thermal heat
Europe	0.44	0.563	0.185	0.197	0.8	0.861	0.433	0.19	0.239	0.101	0.54

Capacity factors of offshore and onshore wind turbines account for array losses (extraction of kinetic energy by turbines). Capacity factors are determined before transmission, distribution, maintenance, storage, or curtailment losses. The symbol “—” indicates no installation of the technology. Rooftop PV panels are fixed-tilt at the optimal tilt angle of the country they reside in; utility PV panels are half fixed optimal tilt and half single-axis horizontal tracking.

**Table 7. Percent of Demand Met by Different WWS Generators**

LOADMATCH 2050-2052 simulation-averaged all-sector projected WWS end-use power supplied (which equals power consumed plus power lost during transmission, distribution, maintenance, and curtailment),, by region and percentage of such supply met by each generator. Simulation-average power supply (GW) equals the simulation total energy supply (GWh/simulation) divided by the number of hours of simulation. The percentages for each region add to 100%. Multiply each percentage by the 2050 total supply to obtain the GW supply by each generator. Divide the GW supply from each generator by its capacity factor (Table 6) to obtain the final 2050 nameplate capacity of each generator needed to meet the supply (Table 5).

Country or region	Annual-average WWS supply (GW)	On-shore wind (%)	Off-shore wind (%)	Roof PV (%)	Utility PV (%)	CSP with storage (%)	Geoth ermal elec-tricity (%)	Hydr opower (%)	Wave (%)	Tidal (%)	Solar therm al heat (%)	Geo-thermal heat (%)
Europe	1,146	34.21	17.22	13.54	25.25	0.26	0.240	7.345	0.044	0.032	0.356	1.493

**Table 8. Characteristics of Storage Resulting in Matching Demand With 100% WWS Supply**

Maximum charge rates, discharge rate, storage capacity, and hours of storage at the maximum discharge rate of all electricity, cold and heat storage needed for supply plus storage to match demand, in the Europe.

Storage type	Max charge rate (GW)	Max discharge rate (GW)	Max storage capacity (TWh)	Max storage time at max discharge rate (h)
PHS	100.4	100.4	1.41	14.0
CSP-elec.	3.81	3.81	--	--
CSP-PCM	6.14	--	0.086	22.6
Batteries	15	15	0.06	4.0
Hydropower	95.20	194.4	247.6	1,274
Base	80.10	80.1	115.3	1,440
Peaking	15.10	114.3	132.3	1,157
Grid H <sub>2</sub>	210.0	210.0	0	0
CW-STES	5.11	5.11	.0716	14.0
ICE	7.67	7.67	.1073	14.0
HW-STES	268.9	268.9	1.613	6.0
UTES-heat	71.94	268.9	32.27	120.0
UTES-elec.	26.9	--	--	--

PHS=pumped hydropower storage; CSP=concentrated solar power; PCM=Phase-change materials; CW-STES=Chilled-water sensible heat thermal energy storage; ICE=ice storage; HW-STES=Hot water sensible heat thermal energy storage; and UTES=Underground thermal energy storage in soil. The maximum storage capacity equals the maximum discharge rate multiplied by the number of hours of storage at that rate.

CSP-elec. is the production of electricity from CSP regardless of whether CSP storage exists. Heat captured in a working fluid by a CSP solar collector can be either used immediately to produce electricity by evaporating water and running it through a steam turbine connected to a generator, stored in a phase-change material, or both. The maximum discharge rate of electricity from CSP generators is the summed nameplate capacity of the generators. The maximum charge rate of such electricity generators is limited to the maximum discharge rate.

CSP-PCM is the phase-change material storage associated with CSP. That storage is discharged for electricity production at the maximum discharge rate of CSP-elec. Thus, the maximum energy storage capacity of CSP-PCM equals the maximum electricity discharge rate of CSP-elec. multiplied by the maximum number of hours of storage at full discharge. The maximum charge rate of CSP phase-change material storage is set to 1.612 multiplied by the maximum electricity discharge rate, which allows more energy to be collected than discharged directly as electricity. Thus, since the high temperature working fluid in the CSP plant can be used to produce electricity and charge storage at the same time, the maximum overall electricity production plus storage charge rate of energy is 2.612 multiplied by the maximum discharge rate. This ratio is also the ratio of the mirror size with storage versus without storage. This ratio can be up to 3.2 in existing CSP plants. The maximum number of hours of storage at full discharge is 22.6 hours, or 1.612 multiplied by the 14 hours required for CSP storage to charge when charging at its maximum rate.

Hydropower's maximum discharge rate (GW) in 2050 is its 2022 nameplate capacity and its annual energy output (TWh/y) in 2050 is close to that in 2022 in every region. Water released from a dam during hydropower production is replenished naturally with rainfall and runoff. Hydropower reservoirs contain water for energy and non-energy purposes. About 50-60% of the water in a reservoir is generally used for energy (IEA, 2021). The hydropower storage capacity available for energy in all reservoirs worldwide is estimated as ~1,470 TWh, broken down as follows: North America: 370 TWh; China: 250 TWh; Latin America: 245 TWh; Europe: 215 TWh; Eurasia: 130 TWh; Africa: 125 TWh; Asia Pacific: 120 TWh; Middle East: 15 TWh (IEA, 2021-Figure 4.8). The maximum hydropower storage capacity (TWh) in each country here is estimated by multiplying these regional storage capacities by the ratio of the 2022 hydroelectric energy output of the country to that of the region the country falls in. The maximum storage capacity in each region is then calculated simply by summing the maximum storage capacities among all countries in the region. The maximum storage capacity and the total nameplate capacity of hydropower generators in each region are then distributed between baseload and peaking power uses by solving a set of six equations and six unknowns: (1) the sum of the maximum energy storage capacities (TWh) for baseload and peaking power equals the total maximum energy storage capacity of all reservoirs in each region, as just determined; (2) the sum of the instantaneous average charge rates (TW) of power for baseload and peaking power equals the total average charge rate of the reservoir, which equals the annual average hydropower power output (TW) of the reservoir in 2022 (which equals the 2022 energy output in TWh/y divided by 8,760 hours per year); (3) the sum of the maximum discharge rates (TW) for each baseload and peaking power equals the total nameplate capacity of all hydropower generators in the region; (4) the maximum discharge rate (TW) of baseload power from generators equals the instantaneous average charge rate of baseload power; (5) the maximum energy storage capacity (TWh) for peaking power equals the instantaneous average charge rate of peaking power (TW) multiplied by 8,760 hours per year (in other words, the peaking portion of the reservoir must be filled once per year); and (6) the maximum energy storage capacity (TWh) for baseload power equals the instantaneous average charge rate of baseload power (TW) multiplied by a designated number of hours of storage of baseload energy. Since the maximum discharge rate of baseload

hydropower is assumed to equal its instantaneous average charge rate, there should be no need for baseload storage. However, in reality, discharged water for baseload power is not replenished immediately. As such, sufficient storage capacity is assigned to baseload hydropower so that, if full, baseload can supply 60 days (1,440 hours) straight of hydroelectricity without any replenishment. For Iceland and South America, 5 and 15 days, respectively, are assumed instead of 60 days. In sum, whereas baseload power is produced and discharged continuously in the model every 30 s, peaking power is also produced every 30 s but discharged only when needed due to a lack of other WWS resources available. Whereas the present table gives hydropower's maximum energy storage capacity available for each baseload and storage, hydropower's output from baseload or peaking storage during a time step is limited by the smallest among three factors: the actual energy currently available in storage for baseload or peaking, the maximum hydro discharge rate for peaking or baseload multiplied by the time step, and (in the case of peaking) the energy needed during the time step to keep the grid stable. In addition, energy in the peaking portion of reservoirs is limited by the maximum storage capacity in that portion. Thus, if peaking energy is not used fast enough, it cannot accumulate due to rainfall and runoff to more than the maximum capacity.

The CW-STES peak discharge rate is set equal to 40% of the annual-average cold demand (for air conditioning and refrigeration) subject to storage. The ICE storage discharge rate is set to 60% of the same annual-average cold demand subject to storage.

The peak charge rate is set equal to the peak discharge rate. Heat pumps are used to produce both cold water and ice.

The HW-STES peak discharge rate is set equal to the maximum instantaneous heat demand subject to storage during any 30-second period of the simulation. The values have been converted to electricity assuming the heat needed for storage is produced by heat pumps (with a coefficient of performance of 4) running on electricity. The peak charge rate is set equal to the peak discharge rate.


UTES heat stored in soil (borehole storage) or water pits can be charged with either solar or geothermal heat or excess electricity running an electric heat pump with a coefficient of performance of 4. The maximum charge rate of heat (converted to equivalent electricity) to UTES storage (UTES-heat) is set to the nameplate capacity of solar thermal collectors plus that of geothermal heat, all divided by the coefficient of performance of a heat pump (=4). When no solar thermal collectors or geothermal heat is used, the maximum charge rate for UTES-heat is zero, and UTES is charged only with excess grid electricity running heat pumps. The maximum charge rate of UTES storage using excess grid electricity (UTES-elec.) is set equal to the maximum instantaneous heat demand subject to storage during any 30-second period of the two-year simulation. The maximum UTES heat discharge rate is set equal to the maximum instantaneous heat demand subject to storage. The maximum charge rate, discharge rate, and capacity of UTES storage are all in units of equivalent electricity that would give heat at a coefficient of performance of 4.

Grid H<sub>2</sub>. Grid hydrogen storage capacity and storage times are set to zero in this table, but the peak charge and discharge rates are not. That is because hydrogen production and storage for grid and non-grid purposes are merged in this study. In such a case, the storage time depends on the discharge rate of both grid and non-grid hydrogen.



### Figure 1. Keeping the Electric Grid Stable With 100% WWS + Storage + Demand Response

2050-2052 hourly time series showing the matching of all-energy demand with supply and storage. First row: modeled time-dependent total WWS power generation versus demand plus losses plus changes in storage plus shedding for the full three-year simulation period. Second row: same as first row, but for a window of 100 days during the simulation. Third row: a breakdown of WWS power generation by source during the window. Fourth row: a breakdown of inflexible demand; flexible electric, heat, and cold demands; flexible hydrogen demand; losses in and out of storage; transmission and distribution losses; changes in storage; and shedding. Fifth row: A breakdown of solar PV+CSP electricity production, onshore plus offshore wind electricity production, building total cold demand, and building total heat demand (as used in LOADMATCH), summed over the countries in each region for 10 days; Sixth row: correlation plots of building heat demand versus wind power output and wind power output versus solar power output, obtained from all hourly data during the simulation. Correlations are very strong for  $R=0.8-1$  ( $R^2=0.64-1$ ); strong for  $R=0.6-0.8$  ( $R^2=0.36-0.64$ ); moderate for  $R=0.4-0.6$  ( $R^2=0.16-0.36$ ); weak for  $0.2-0.4$  ( $R^2=0.04-0.16$ ); and very weak for  $0-0.2$  ( $R^2=0-0.04$ ). The model was run at 30-s resolution. Results are shown hourly, so units are energy output (TWh) per hour increment, thus also in units of power (TW) averaged over the hour. No load loss occurred during any 30-s interval. Results are shown for the Europe.

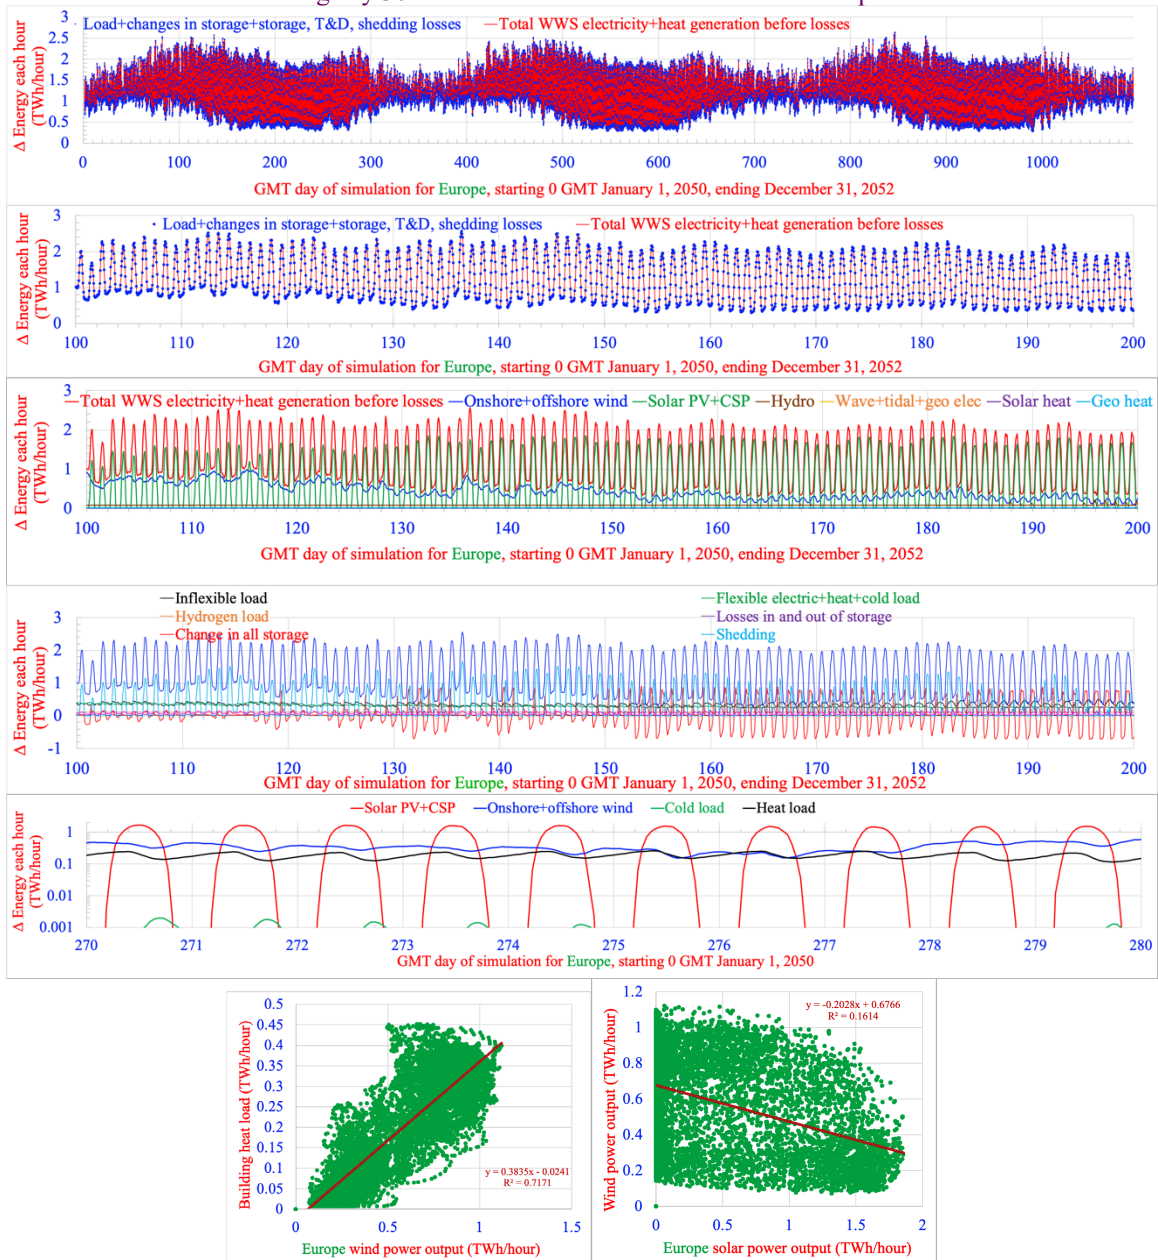



**Table 9. Summary of Energy Budget Resulting in Grid Stability**

Budget of simulation-averaged end-use power demand met, energy lost, WWS energy supplied, and changes in storage, during the three-year (26,291.4875 hour) simulations. All units are GW averaged over the simulation. TD&M losses are transmission, distribution, and maintenance losses. Wind turbine array losses are already accounted for in the “WWS supply before losses” numbers,” since wind supply values come from GATOR-GCMOM, which accounts for such losses.

Country or region	(a) Annual average end-use demand (GW)	(b) TD&M losses (GW)	(c) Storage losses (GW)	(d) Shedding losses (GW)	(e) End-use demand+ losses =a+b+ c+d (GW)	(f) WWS supply before losses (GW)	(g) Changes in storage (GW)	(h) Supply+changes in storage =f+g (GW)
Europe	876.48	76.45	58.20	136.43	1,147.6	1,146	1.597	1,147.6

**Table 10. Details of Energy Budget Resulting in Grid Stability**

Budget of total end-use energy demand met, energy lost, WWS energy supplied, and changes in storage, during the three-year (26,291.4875 hour) simulation. All units are TWh over the simulation. Divide by the number of hours of simulation to obtain simulation-averaged power values, which are provided in Table 9 for key parameters.

	<b>Europe</b>
<b>A1. Total end use demand</b>	<b>23,043.9</b>
Electricity for electricity inflexible demand	11,940.8
Electricity for electricity, heat, cold storage + DR	8,165.4
Electricity for H <sub>2</sub> direct use + H <sub>2</sub> storage	2,937.7
<b>A2. Total end use demand</b>	<b>23,043.9</b>
Electricity for direct use, electricity storage, + H <sub>2</sub>	21,396.3
Low-T heat demand met by heat storage	1,601.3
Cold demand met by cold storage	46.35
<b>A3. Total end use demand</b>	<b>23,043.9</b>
Electricity for direct use, electricity storage, DR	16,609.3
Electricity for H <sub>2</sub> direct use + H <sub>2</sub> storage	2,937.7
Electricity + heat for heat subject to storage	3,160.9
Electricity for cold demand subject to storage	335.97
<b>B. Total losses</b>	<b>7,127</b>
Transmission, distribution, downtime losses	2,009.92
Losses CSP storage	0.2419
Losses PHS storage	37
Losses battery storage	5
Losses grid H <sub>2</sub> storage	1,182
Losses CW-STES + ICE storage	8
Losses HW-STES storage	204
Losses UTES storage	94
Losses from curtailment	3,586.9
<b>Net end-use demand plus losses (A1 + B)</b>	<b>30,170.8</b>
<b>C. Total WWS supply before T&amp;D losses</b>	<b>30,128.9</b>
Onshore + offshore wind electricity	15,493.0
Rooftop + utility PV+ CSP electricity	11,770.9
Hydropower electricity	2,212.6
Wave electricity	13.26
Geothermal electricity	72.27
Tidal electricity	9.707
Solar heat	107.4171
Geothermal heat	449.6054
<b>D. Net taken from (+) or added to (-) storage</b>	<b>41.9918</b>
CSP storage	-0.0034
PHS storage	1.2652
Battery storage	-0.006
Grid H <sub>2</sub> storage	0
CW-STES+ICE storage	0.161
HW-STES storage	1.452
UTES storage	29.0407
Non-grid H <sub>2</sub> storage	10.0822
<b>Energy supplied plus taken from storage (C+D)</b>	<b>30,170.8</b>

End-use demands in A1, A2, A3 should be identical. Electricity production is curtailed when it exceeds the sum of electricity demand, cold storage capacity, heat storage capacity, and H<sub>2</sub> storage capacity.

**Table 11. Breakdown of Energy Costs Required to Keep Grid Stable**

Summary of 2050 WWS mean capital costs of new electricity plus heat generators; electricity, heat, cold, and hydrogen storage (including heat pumps to supply district heating and cooling), and all-distance transmission/distribution (\$ trillion in 2020 USD) and mean levelized private costs of energy (LCOE) (USD ¢/kWh-all-energy or ¢/kWh-electricity-replacing-BAU-electricity) averaged over each simulation. Also shown is the energy consumed per year in each case and the resulting aggregate annual energy cost.

	Europe
Capital cost new generators only (\$tril)	3.541
<b>Cap cost generators-storage-H<sub>2</sub>-HVDC (\$tril)</b>	<b>5.064</b>
<i>Components of total LCOE (¢/kWh-all-energy)</i>	
Short-dist. transmission	1.050
Long-distance transmission	0.193
Distribution	2.375
Electricity generation	3.456
Additional hydro turbines	0
Geothermal + solar thermal heat generation	0.127
LI battery storage	0.004
Grid H <sub>2</sub> production/compression/storage/fuel cell	0.114
CSP-PCM + PHS storage	0.012
CW-STES + ICE storage	0.002
HW-STES storage	0.014
UTES storage	0.038
Heat pumps for filling district heating/cooling	0.047
Non-grid H <sub>2</sub> production/compression/storage	1.069
<b>Total LCOE (¢/kWh-all-energy)</b>	<b>8.50</b>
LCOE (¢/kWh-replacing BAU electricity)	7.308
GW annual avg. end-use demand	876.4
TWh/y end-use demand (GW x 8,760 h/y)	7,678
<b>Annual energy cost (\$billion/y)</b>	<b>652.8</b>
<b>% rise in LCOE &amp; annual cost if 1.5x battery cost</b>	<b>0.02</b>

LI=lithium ion; CSP=concentrated solar power; PCM=Phase-change materials; PHS=pumped hydropower storage; CW-STES=Chilled-water sensible heat thermal energy storage; ICE=ice storage; HW-STES=Hot water sensible heat thermal energy storage; and UTES=Underground thermal energy storage in boreholes or water pits.

The LCOEs are derived from capital costs, annual O&M, and end-of-life decommissioning costs that vary by technology and that are a function of lifetime and a social discount rate for an intergenerational project of 2.0 (1-3)%, all divided by the total annualized end-use demand met, given in the present table. Capital costs are an average between 2020 and 2050, as are the LCOEs.

Capital cost of generators-storage-H<sub>2</sub>-HVDC (\$trillion) is the capital cost of new electricity and heat generation, short- and long-distance (HVDC) transmission and distribution, battery storage, concentrated solar power with storage, pumped hydropower storage, cold water storage, ice storage, hot water storage, underground thermal energy storage, heat pumps for district heating and cooling, and hydrogen production and use-electrolyzers, rectifiers, storage tanks, water, dispensing, cooling, and fuel cells.

Since the total end-use demand includes heat, cold, hydrogen, and electricity demands (all energy), the “electricity generator” cost, for example, is a cost per unit all energy rather than per unit electricity alone. The ‘Total LCOE’ gives the overall cost of energy, and the ‘Electricity LCOE’ gives the cost of energy for the electricity portion of demand replacing BAU electricity end use. It is the total LCOE less the costs for UTES and HW-STES storage, H<sub>2</sub>, and less the portion of long-distance transmission associated with H<sub>2</sub>.

Short-distance transmission costs are \$0.0105 (0.01-0.011)/kWh.

Distribution costs are \$0.02375 (0.023-0.0245)/kWh.

Long-distance transmission costs are \$0.0089 (0.0042-0.010)/kWh (in USD 2020) assume 1,500 to 2,000 km HVDC lines, a capacity factor usage of the lines of ~50% and a capital cost of ~\$400 (300-460)/MWtr-km.

**Table 12. Energy, Health, and Climate Costs of WWS Versus BAU**

2050 annual-average end-use (a) BAU demand and (b) WWS demand; (c) percentage difference between WWS and BAU demand; (d) present value of the mean total capital cost for new WWS electricity, heat, cold, and hydrogen generation and storage and all-distance transmission and distribution; mean levelized private costs of all (e) BAU and (f) WWS energy (¢/kWh-all-energy-sectors, averaged between today and 2050); (g) mean WWS private (equals social) energy cost per year; (h) mean BAU private energy cost per year; (i) mean BAU health cost per year; (j) mean BAU climate cost per year; (k) BAU total social cost per year; (l) percentage difference between WWS and BAU private energy cost; and (m) percentage difference between WWS and BAU social energy cost. All costs are in 2020 USD. H=8760 hours per year.

Country or region	(a) <sup>1</sup> 2050 BAU Annual avg. end-use demand (GW)	(b) <sup>1</sup> 2050 WWS Annual avg. end-use demand (GW)	(c) 2050 WWS minus BAU demand = (b-a)/a (%)	(d) <sup>2</sup> WWS mean total cap- ital cost (\$tril 2020)	(e) <sup>3</sup> BAU mean private energy cost ¢/kWh- all energy	(f) <sup>4</sup> WWS mean private energy cost ¢/kWh- all energy	(g) <sup>5</sup> WWS mean annual all- energy private and social cost = bfH \$/bil/	(h) <sup>5</sup> BAU mean annual all- energy private cost = aeH \$/bil/y	(i) <sup>6</sup> BAU mean annual BAU health cost \$/bil/y	(j) <sup>7</sup> BAU mean annual climate cost (\$bil/y)	(k) BAU mean annual BAU total social cost =h+i+j \$/bil/y	(l) WWS minus BAU private energy cost = (g-h)/h (%)	(m) WWS minus BAU social energy cost = (g-k)/k (%)
Austria	44.0	19.5	-55.8	0.092	10.06	8.50	14.5	38.8	20.3	48.5	108	-62.7	-86.5
Europe	2,053.7	876.4	-57.3	5.064	10.06	8.50	652.8	1,809.7	1,772	2,626.9	6,209	-63.9	-89.5

<sup>2</sup>The total capital cost includes the capital cost of new WWS electricity and heat generators; new electricity, heat, cold, and hydrogen storage equipment; hydrogen electrolyzers and compressors; heat pumps for district heating/cooling; and long-distance (HVDC) transmission lines. Capital costs are an average between 2020 and 2050.

<sup>3</sup>This is the BAU electricity-sector cost per unit energy. It is assumed to equal the BAU all-energy cost per unit energy and is an average between 2020 and 2050.

<sup>4</sup>The WWS cost per unit energy is for all energy, which is almost all electricity (plus a small amount of direct heat). It is an average between 2020 and 2050.

<sup>5</sup>The annual private cost of WWS or BAU energy equals the cost per unit energy from Column (f) or (e), respectively, multiplied by the energy consumed per year, which equals the end-use demand from Column (b) or (a), respectively, multiplied by 8,760 hours per year.

<sup>6</sup>The 2050 annual BAU health cost equals the number of total air pollution deaths per year in 2050 multiplied by 90% (the estimated percentage of total air pollution mortalities that are due to energy) and by a value of statistical life (VOSL) calculated for each country, and a multiplier of 1.15 for morbidity and another multiplier of 1.1 for non-health impacts.

<sup>7</sup>The 2050 annual BAU climate cost equals the 2050 CO<sub>2e</sub> emissions multiplied by the mean social cost of carbon in 2050 (in 2020 USD).

**Table 13. Air Pollution Mortalities, Carbon Dioxide Emissions, and Associated Costs**

(a) Estimated 2050 air pollution mortalities per year due to all sources of air pollution (about 90% of which are due to energy sources); (b) 2050 carbon dioxide-equivalent emissions (CO<sub>2e</sub>) from energy sources; (c) cost per tonne-CO<sub>2e</sub>-eliminated of converting to WWS; (d) BAU energy cost per tonne-CO<sub>2e</sub> emitted; (e) BAU health cost per tonne-CO<sub>2e</sub> emitted; (f) BAU climate cost per tonne-CO<sub>2e</sub> emitted (social cost of carbon); (g) BAU total social cost per tonne-CO<sub>2e</sub> emitted; (h) BAU health cost per unit-all-BAU-energy produced; and (i) BAU climate cost per unit-all-BAU-energy produced..

Country or region	(a) <sup>1</sup> 2050 BAU air pollution mortalities (Deaths/y)	(b) <sup>2</sup> 2050 BAU CO <sub>2e</sub> (Mtonne/y)	(c) <sup>3</sup> 2050 WWS (\$/ tonne- CO <sub>2e</sub> - elim- inated)	(d) <sup>4</sup> 2050 BAU energy cost (\$/ tonne- CO <sub>2e</sub> - emitted)	(e) <sup>4</sup> 2050 BAU health cost (\$/ tonne- CO <sub>2e</sub> - emitted)	(f) <sup>4</sup> 2050 BAU climate cost (\$/ tonne- CO <sub>2e</sub> - emitted)	(g) <sup>4</sup> 2050 BAU social cost = d+e+f (\$/ tonne- CO <sub>2e</sub> - emitted)	(h) <sup>5</sup> 2050 BAU health cost (¢/kWh)	(i) <sup>5</sup> 2050 BAU climate cost (¢/kWh)
Austria	1,741	87	166.9	447	234	559	1,240	5.3	12.6
Europe	179,603	4,705	138.7	385	377	558	1,320	9.9	14.6

<sup>1</sup>2050 country BAU mortalities due to air pollution are extrapolated from 2016 values from WHO (2017).

<sup>2</sup>CO<sub>2e</sub>=CO<sub>2</sub>-equivalent emissions. This accounts for the emissions of CO<sub>2</sub> plus the emissions of other greenhouse gases multiplied by their global warming potentials. The emissions from these 149 countries represent 99.75% of world anthropogenic CO<sub>2e</sub> emissions.

<sup>3</sup>Calculated as the WWS private energy and total social cost divided by the CO<sub>2e</sub> emission rate from Column (b) of the present table.

<sup>4</sup>Columns (d)-(g) are calculated as the BAU private energy cost, health cost, climate cost, and total social costs respectively, each divided by the CO<sub>2e</sub> emissions.

<sup>5</sup>Columns (h)-(i) are calculated as the BAU health and climate costs, respectively, each divided by the BAU end-use demand and by 8,760 hours per year.

**Table 14. Land Areas Needed**

Footprint areas for *new* utility PV farms, CSP plants, solar thermal plants for heat, geothermal plants for electricity and heat, and hydropower plants and spacing areas for new onshore wind turbines.

Country or region	Country or region land area (km <sup>2</sup> )	Footprint Area (% of region land area)	Spacing area (% of region land area)	Footprint plus spacing area as percentage of the country or region land area (%)
Austria	82,409	0.45	0.63	1.08
Europe	5,671,860	0.29	0.61	0.90

Spacing areas are areas between wind turbines needed to avoid interference of the wake of one turbine with the next. Such spacing area can be used for multiple purposes, including farmland, rangeland, open space, or utility PV. Footprint areas are the physical land areas, water surface areas, or sea floor surface areas removed from use for any other purpose by an energy technology. Rooftop PV is not included in the footprint calculation because it does not take up new land. Conventional hydro new footprint is zero because no new dams are proposed as part of these roadmaps. Offshore wind, wave, and tidal are not included because they don't take up new land. Areas are given both as an absolute area and as a percentage of the country or regional land area, which excludes inland or coastal water bodies. For comparison, the total area and land area of Earth are 510.1 and 144.6 million km<sup>2</sup>, respectively.

**Table 15. Changes in the Employment**

Estimated long-term, full-time jobs created and lost due to transitioning from BAU energy to 100% WWS across all energy sectors. The job creation accounts for new jobs in the electricity, heat, cold, and hydrogen generation, storage, and transmission (including HVDC transmission) industries. It also accounts for the building of heat pumps to supply district heating and cooling. However, it does not account for changes in jobs in the production of electric appliances, vehicles, and machines or in increasing building energy efficiency. Construction jobs are for new WWS devices only. Operation jobs are for new and existing devices. The losses are due to eliminating jobs for mining, transporting, processing, and using fossil fuels, biofuels, and uranium. Fossil-fuel jobs due to non-energy uses of petroleum, such as lubricants, asphalt, petrochemical feedstock, and petroleum coke, are retained. For transportation sectors, the jobs lost are those due to transporting fossil fuels (e.g., through truck, train, barge, ship, or pipeline); the jobs not lost are those for transporting other goods. The table does not account for jobs lost in the manufacture of combustion appliances, including automobiles, ships, or industrial machines.

Country or region	Total jobs produced	Jobs lost	Net change in jobs
Austria	106,488	44,138	62,350
Europe	5,121,737	2,112,592	3,009,145

## References

- IEA (International Energy Agency). *Hydropower special market report*. [https://iea.blob.core.windows.net/assets/4d2d4365-08c6-4171-9ea2-8549fabd1c8d/HydropowerSpecialMarketReport\\_corr.pdf](https://iea.blob.core.windows.net/assets/4d2d4365-08c6-4171-9ea2-8549fabd1c8d/HydropowerSpecialMarketReport_corr.pdf) (2021).
- IEA (International Energy Agency) Energy Statistics Data Browser. *OECD Publishing, Paris*. <https://www.iea.org/data-and-statistics/data-tools/energy-statistics-data-browser?> (2023).
- WHO (World Health Organization) (2017). Global health observatory data. Retrieved August 10, 2021, from, [https://www.who.int/gho/phe/outdoor\\_air\\_pollution/en](https://www.who.int/gho/phe/outdoor_air_pollution/en)

## Additional Background Material on 100% WWS

- Jacobson, M.Z., *100% Clean, Renewable Energy and Storage for Everything*, Cambridge University Press, New York, 427 pp. (2020).
- Jacobson, M.Z., von Krauland, A.-K., Coughlin, S.J., Dukas, E., Nelson, A.J.H., Palmer, F.C. & Rasmussen, K.R. Low-cost solutions to global warming, air pollution, and energy insecurity for 145 countries. *Energy and Environmental Sciences* **15**, 3343-3359 (2022).
- Jacobson, M.Z., *No Miracles Needed: How Today's Technology can Save our Climate and Clean our Air*, Cambridge University Press, New York, 437 pp. (2023).
- Jacobson, M.Z., von Krauland, A.-K., Song, K. & Krull, A.N. Impacts of green hydrogen for steel, ammonia, and long-distance transport on the cost of meeting electricity, heat, cold, and hydrogen demand in 145 countries running on 100% wind-water-solar. *Smart Energy* **11**, 100106 (2023).